



\* EXTEND PAD MINIMUM 12" FROM OUTSIDE EDGE OF WIDEST FITTING ON BOTH LONG SIDES

### PLAN

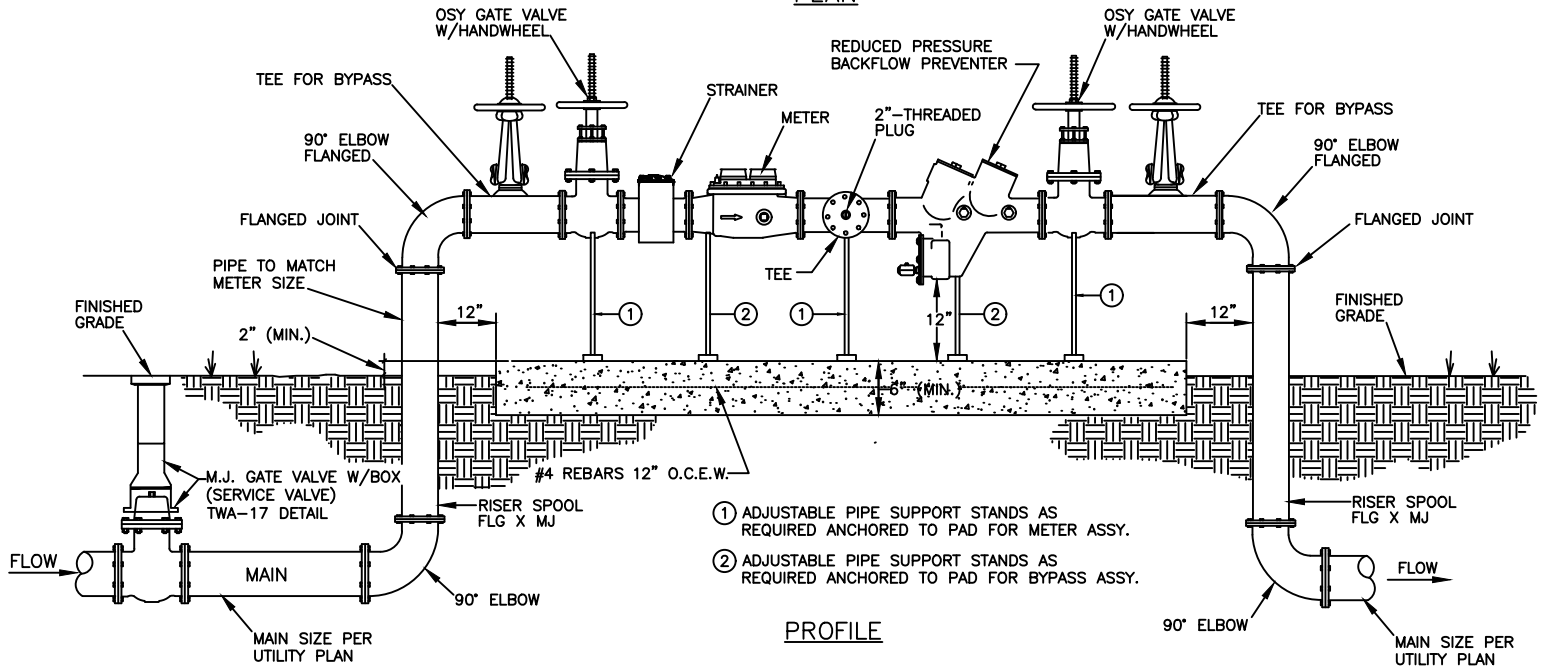

### PROFILE

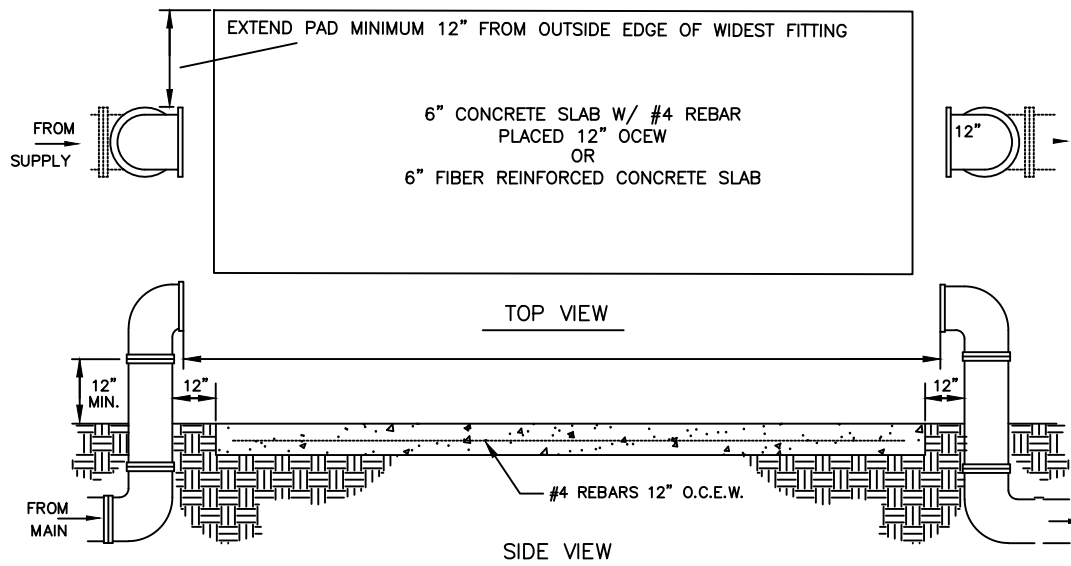

### NOTES:

1. ALL PIPING, VALVES, FITTINGS, AND BACKFLOWS INCLUDED IN THE ASSEMBLY SHALL MATCH THE SIZE OF THE METER
2. ALL FITTINGS INCLUDING BUT NOT LIMITED TO THE STRAINER, METER, CHECK VALVE, TEE, ETC. SHALL BE THE RESPONSIBILITY OF THE DEVELOPER AND/OR CONTRACTOR TO PROVIDE AND INSTALL
3. GALVANIZED PIPE IS NOT ALLOWED
4. PROTECTIVE BOLLARD(S) MAY BE REQUIRED AT THE DISCRETION OF TOHO
5. MAINTAIN A MINIMUM 3' CLEARANCE AROUND ALL SIDES OF THE ASSEMBLY FREE OF PLANTINGS, STRUCTURES, OTHER UTILITIES, ETC.