


LIMITED RIGHT-OF-WAY CONDITION

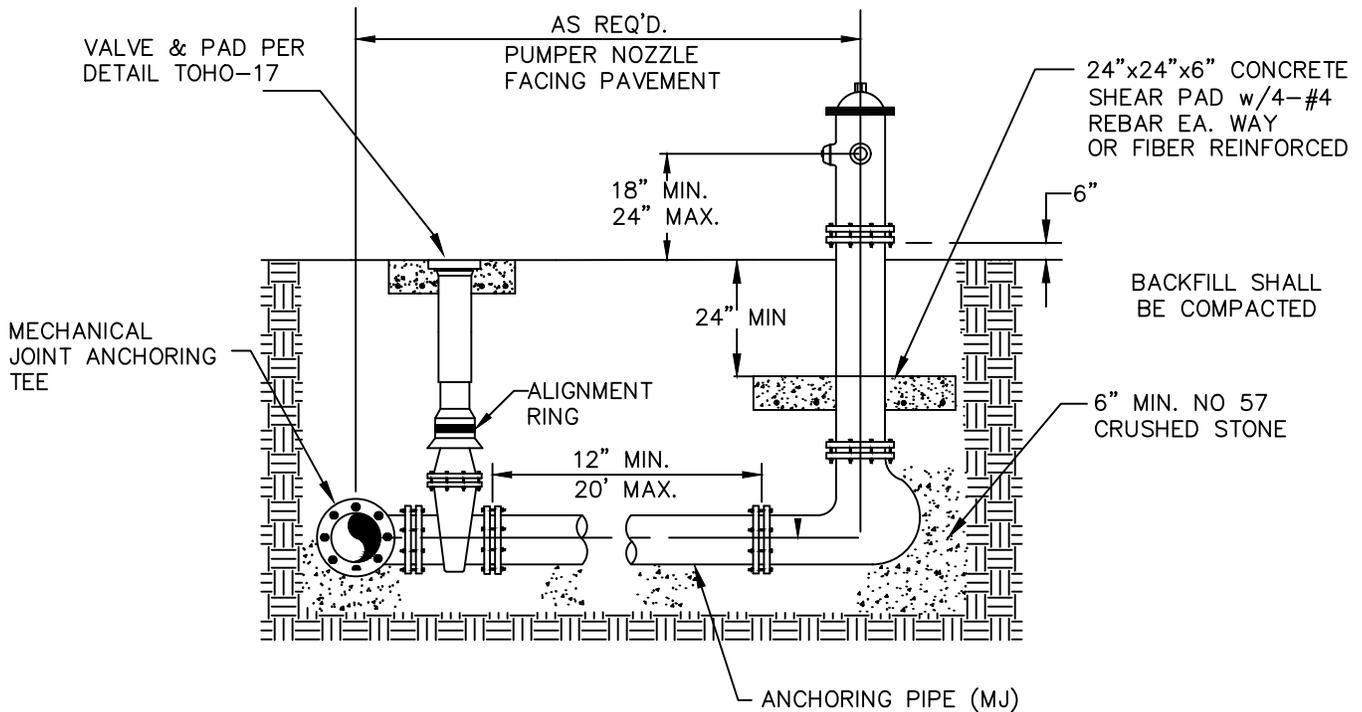

TYPICAL CONDITION

NOTES:

1. HYDRANT SHALL BE SUPPLIED WITHOUT A WEEP HOLE OR WITH A PERMANENTLY PLUGGED WEEP HOLE
2. CLEARANCE BETWEEN BOTTOM OF BOLTS AND FINISH GRADE SHALL BE 6" MINIMUM
3. CLEARANCE BETWEEN PUMPER NOZZLE CENTER AND FINISH GRADE SHALL BE 18" MINIMUM AND 24" MAXIMUM
4. PLANTING CLEAR AREA(S) SHALL BE PER APPLICABLE FIRE CODE(S)
5. IF HYDRANT IS LOCATED MORE THAN 20 LINEAR FEET FROM THE MAIN, AN ADDITIONAL GATE VALVE SHALL BE REQUIRED IMMEDIATELY UPSTREAM OF THE HYDRANT
6. VALVE, VALVE BOX, & PAD SHALL BE INSTALLED PER VALVE & BOX TOHO-17