

TOHO WATER AUTHORITY

951 Martin Luther King Blvd., Kissimmee, FL 34741
Phone: (407)944-5031; Fax: (407)343-4264
www.TohoWater.com

SPILL REPORT

Address: _____ Date: _____ Time: _____

Customer Call Received By: N/A

Name(s) of Personnel on Site: _____

Time Crew Arrived on Site: _____ Date: _____

Time Crew Departed Site: _____ Date: _____

SERVICE AREA(ZONE)

TYPE OF SPILL Wastewater Chemical _____

Manhole #'s: _____

Forcemain location: _____

WWTP MH/FM flows to: _____

Pump Station Failure:	Electrical <input type="checkbox"/>	Power <input type="checkbox"/>	Mechanical <input type="checkbox"/>	Lightning <input type="checkbox"/>
Gravity Main/lateral Blockage:	Grease <input type="checkbox"/>	Roots <input type="checkbox"/>	Debris <input type="checkbox"/>	Other <input type="checkbox"/>
Forcemain Failure:	Contractor <input type="checkbox"/>	Pipe Material <input type="checkbox"/>	ARV <input type="checkbox"/>	Other <input type="checkbox"/>

Time Spill Started: _____ Date: _____ Time Spill Stopped: _____ Date: _____

Estimated Total Volume of Spill: _____ gallons

Estimated Total Volume to Surface Water: _____ gallons

Estimated Total Volume of Spill Recovered: _____ gallons

*Please note if any part of the spill reached private property, if so, note the address

DESCRIPTION OF WHAT CAUSED THE OVERFLOW (BE SPECIFIC and include location map on next page):

IMMEDIATE CORRECTIVE and/or **SAFETY MEASURES INIATED** [if applicable, include a statement(s) describing ongoing or planned repair or rehabilitation activities to improve system reliability/performance to minimize the potential for spills]

INCIDENT REPORTED TO:

TWA Environmental Compliance Manager FDEP
Environmental Department (407)944-5037
(689)312-3104

environmental@tohowater.com

Phone: (407)944-5037

State Watch Office
1-800-320-0519
Response Center
1-800-424-8802

Incident Report #


Fax: (407)343-4264


Reported by: _____ Supervisor: _____

Title: _____ Title: _____

Immediately report wastewater spills of 1,000 gallons or more to State Watch. Immediately report any quantity of chemical spilled to both State Watch & National Response Center

Place Location Map Below



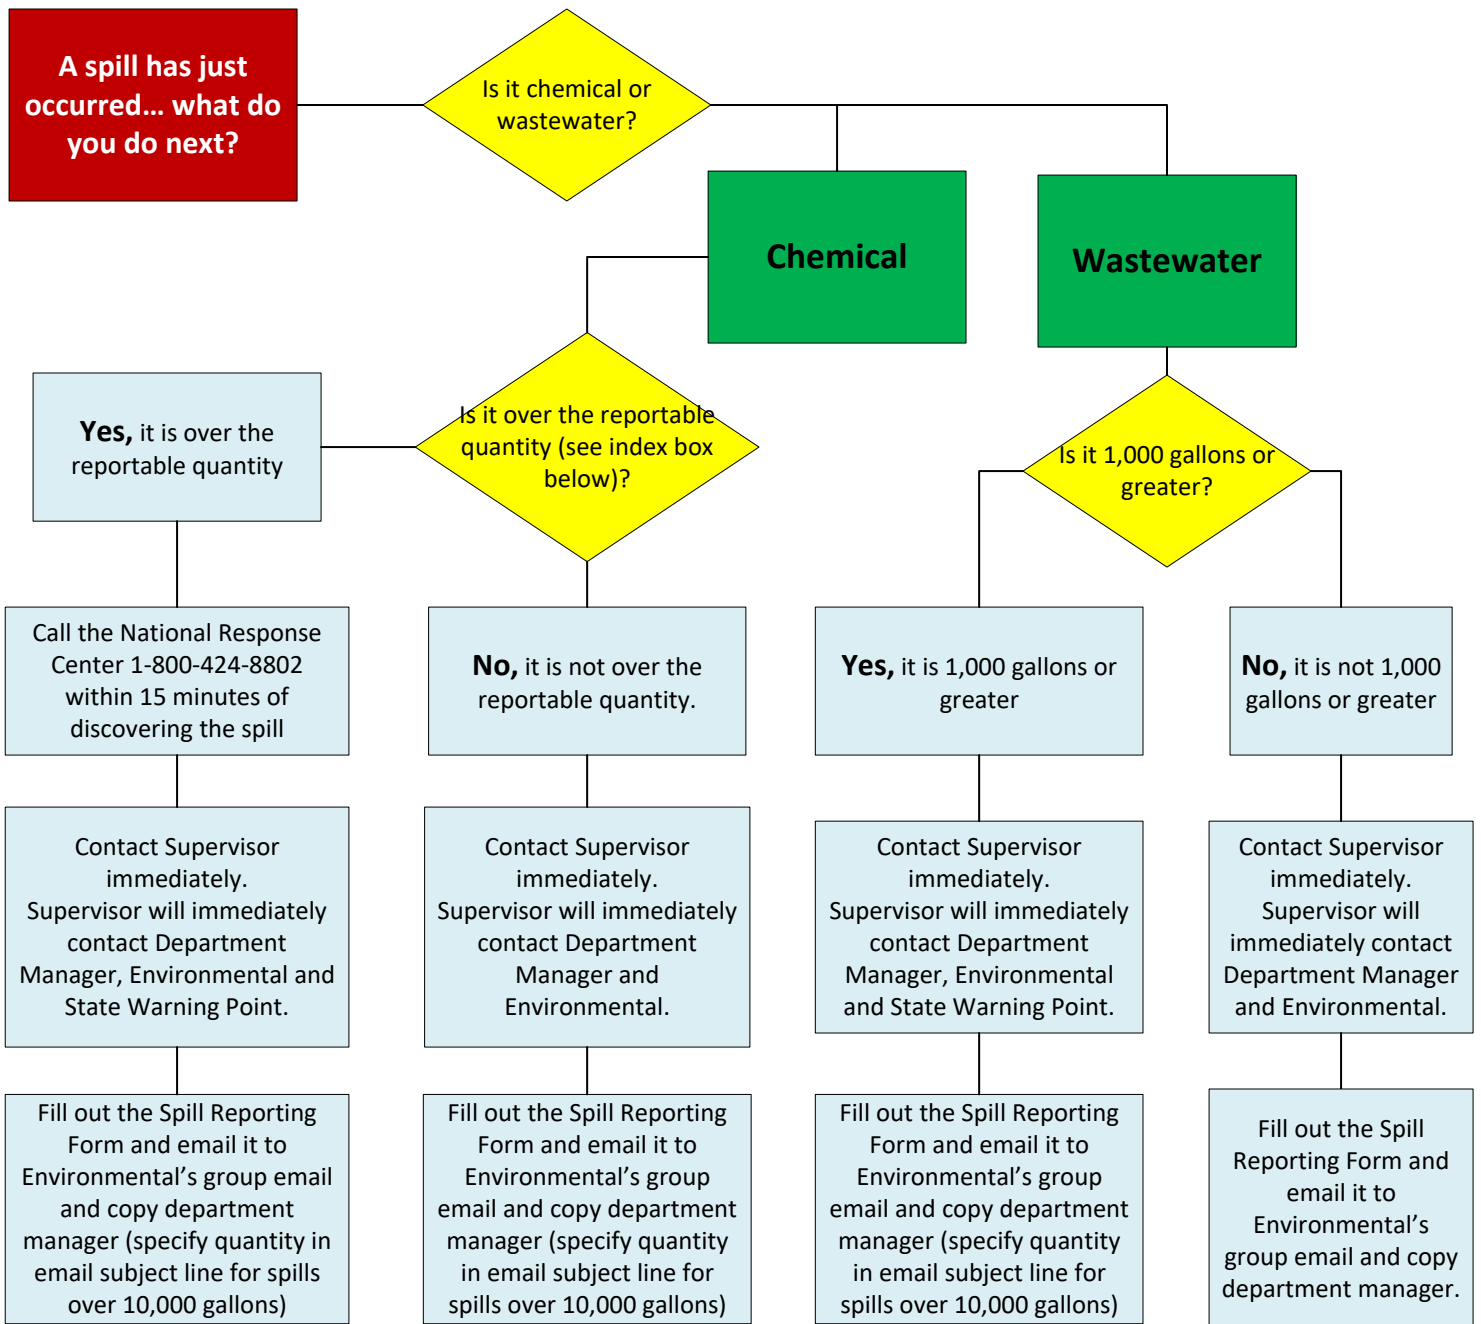

Important: Spills over 10,000 gallons should be immediately reported to the Executive Director in addition to the Env. Dept.

State Warning Point.....1-800-320-0519

Environmental Department Contact List:

environmental@tohowater.com

- Oscar Gonzalez 407-944-5031
- Amber Morgan 407-944-5017
- Nina Cudahy 407-483-3807
- Hillary Weber 407-840-0084

Department Managers:

- Don Vedner (Wastewater)..... 407-501-1259
- Josh Leslie (Field Ops)..... 407-572-3692
- Chuck Weber (Water)..... 407-840-0074

Reportable Quantities for Chemicals:

- Sodium hypochlorite (12.5%)... 77 gallons
- Sodium hydroxide 50 gallons
- Ferric sulfate 75 gallons
- Ammonia hydroxide 133 gallons
- Fluorosilicic acid- there is no reportable quantity but it is hazardous so precautions should be taken during handling.

Diesel:

The reportable quantity is 13 gallons. If you witness a diesel spill, contact the Environmental Department.