


* EXTEND PAD MINIMUM 12" FROM OUTSIDE EDGE OF WIDEST FITTING ON BOTH LONG SIDES

PLAN



ASSEMBLY

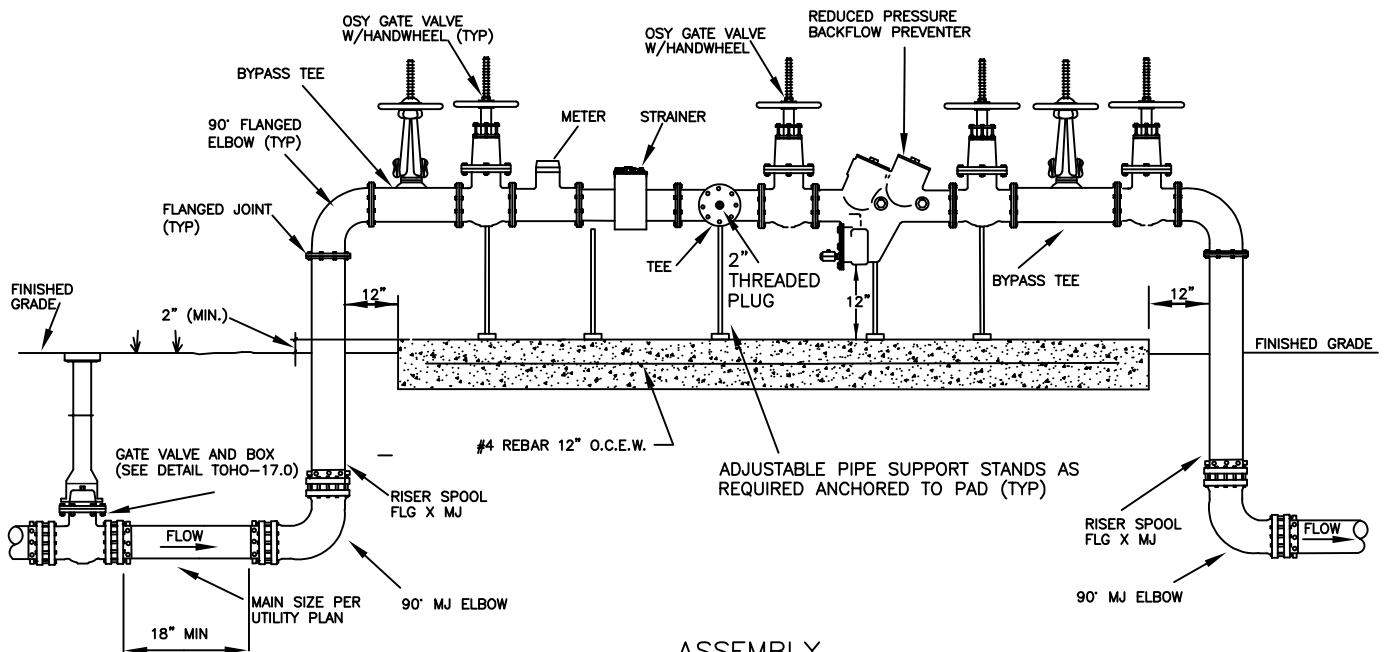

8" CONCRETE SLAB W/ #4 REBAR
PLACED 12" OCEW
OR
8" FIBER REINFORCED CONCRETE SLAB



NOTES:

1. ALL PIPING, VALVES, FITTINGS, AND BACKFLOWS INCLUDED IN THE ASSEMBLY SHALL MATCH THE SIZE OF THE METER.
2. ALL FITTINGS INCLUDING BUT NOT LIMITED TO THE STRAINER, METER, CHECK VALVE, TEE, ETC. SHALL BE THE RESPONSIBILITY OF THE DEVELOPER AND/OR CONTRACTOR TO PROVIDE AND INSTALL.
3. GALVANIZED PIPE, SCH PVC PIPE, THREADED, OR PUSH JOINT FITTINGS ARE NOT ALLOWED. PROTECTIVE BOLLARD(S) MAY BE REQUIRED AT THE DISCRETION OF TOHO.
4. MAINTAIN A MINIMUM 3' CLEARANCE AROUND ALL SIDES OF THE ASSEMBLY FREE OF PLANTINGS, STRUCTURES, OTHER UTILITIES, ETC.



EFFECTIVE DATE:	04/01/2025
BOARD APPROVED DATE:	01/22/2025
PREVIOUS VERSION:	2022
DRAWN BY:	MP
REVISED BY:	DT

LARGE POTABLE METER ASSEMBLY

DRAWING NUMBER

23