


REUSE WATER
MAIN



NOTES:

1. SOLENOID CONTROL VALVES SHALL BE ELECTRONICALLY ACTUATED. PRESSURE TRANSMITTERS LOCATED UPSTREAM OF THE METER ASSEMBLIES SHALL BE PROVIDED BY THE OWNER/DEVELOPER AND INSTALLED BY THE CONTRACTOR.
2. ELECTRONIC ACTUATION WILL REQUIRE PERMANENT SHORE POWER TO BE PROVIDED BY THE OWNER/DEVELOPER AND INSTALLED BY THE CONTRACTOR.
3. SOLENOID CONTROL VALVES TO BE INSTALLED IN-GROUND IN TOHO APPROVED VAULTS.
4. WHERE REQUIRED, ELECTRONIC CONTROL OR INTERFACE DEVICES SHALL BE INSTALLED NEXT TO THE METER REGISTERING TOHO REUSE WATER FLOW.
5. VALVES, ELECTRONICS, AND SITE SPECIFIC PLAN SHALL BE PROVIDED BY THE OWNER/DEVELOPER AND APPROVED BY TOHO PRIOR TO CONSTRUCTION.

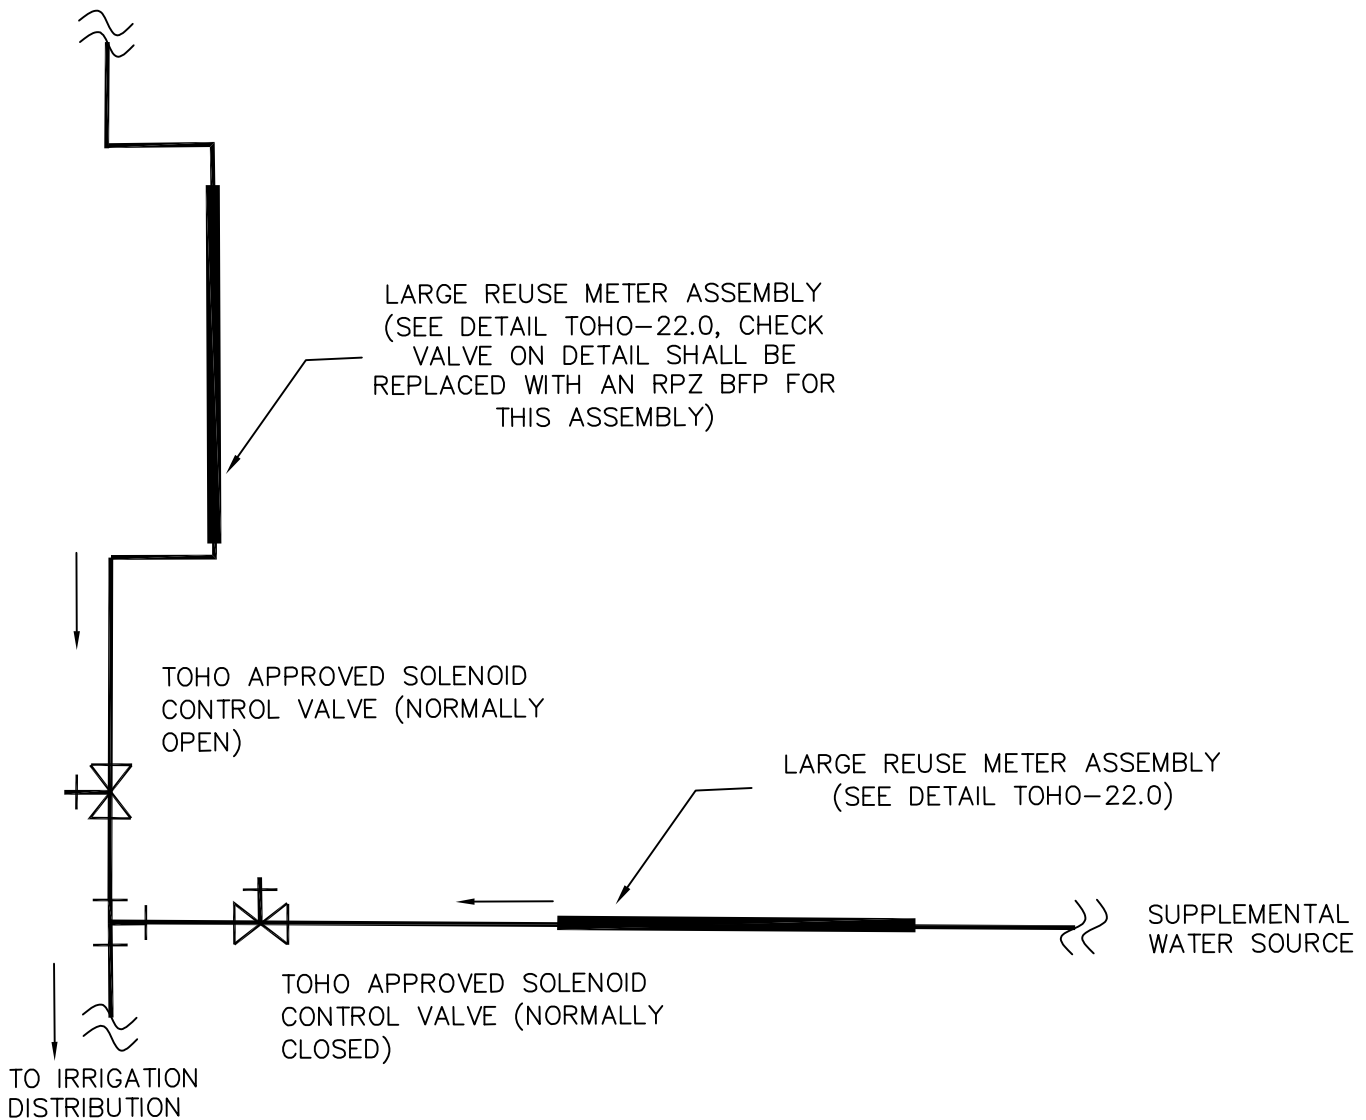

EFFECTIVE DATE:	04/01/2025
BOARD APPROVED DATE:	01/22/2025
PREVIOUS VERSION:	NA
DRAWN BY:	DT
REVISED BY:	DT

**REUSE WITH SUPPLEMENTAL
IRRIGATION LAYOUT**

DRAWING NUMBER

22.3