


UN-DEVELOPED LOT

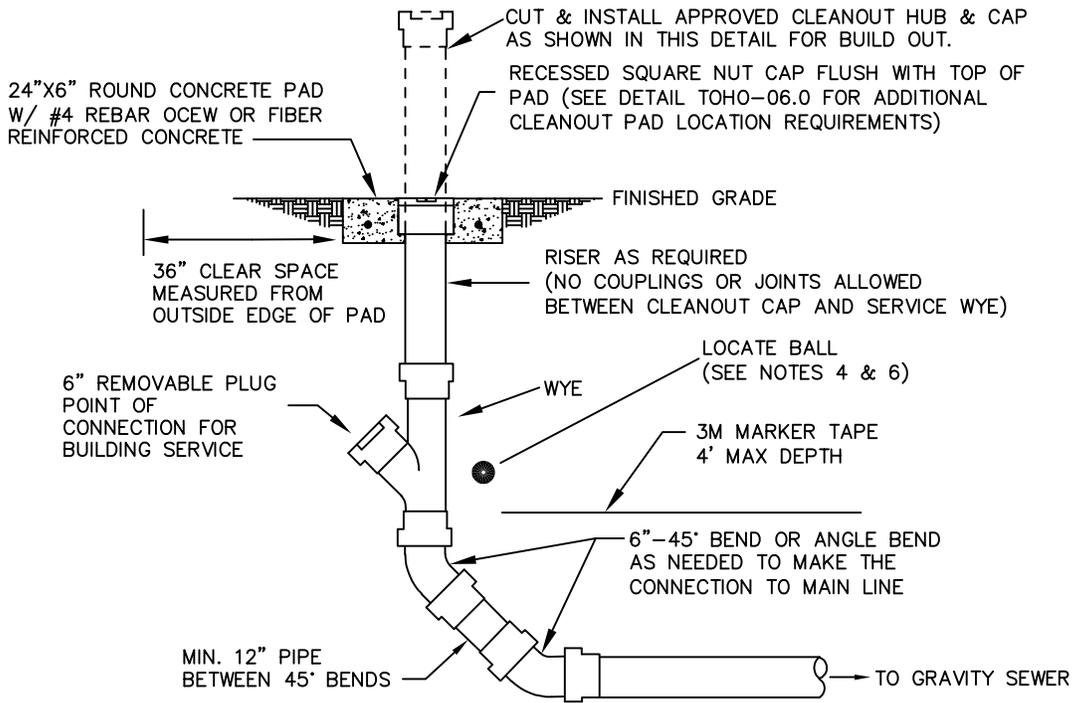

LOT BUILD OUT

NOTES:

1. SITE CONTRACTOR SHALL LEAVE THE CLEANOUT RISER 3' - 4' ABOVE FINISHED GRADE. AT LOT BUILD OUT THE RISER SHALL BE CUT AND CAPPED WITH A CLEANOUT HUB AND CAP INSTALLED IN A CONCRETE PAD SET FLUSH WITH FINISH GRADE OR IN A CAST IRON HANDHOLE IF IN A DRIVEWAY.
2. CLEANOUT CAPS SHALL HAVE A RECESSED SQUARE NUT.
3. NO PLANTINGS, STRUCTURES, OR OTHER UTILITIES, INCLUDING BUT NOT LIMITED TO TELECOM PEDESTALS, ELECTRICAL TRANSFORMERS OR POLES, OR OTHER CLEANOUTS USED FOR TESTING PURPOSES SHALL BE INSTALLED WITHIN 36" OF ANY SIDE OF THE TOHO CLEANOUT.
4. PROVIDE TOHO APPROVED LOCATE BALLS AT ALL SINGLE AND DOUBLE SERVICE WYES.
5. PLUMBER SHALL CONNECT TO SERVICE WYE WITH GASKETED PUSH FITTING ONLY. GLUE OR NON GASKETED FITTINGS SHALL NOT BE PERMITTED.
6. SEE SANITARY SEWER LATERAL DETAIL TOHO-05 AND SANITARY SEWER CLEANOUT PAD TOHO-06.1 FOR ADDITIONAL NOTES AND REQUIREMENTS.

	EFFECTIVE DATE:	04/01/2025
	BOARD APPROVED DATE:	01/22/2025
	PREVIOUS VERSION:	2022
	DRAWN BY:	MP
	REVISED BY:	DT

SANITARY SEWER CLEANOUT

DRAWING NUMBER
06.0