


TYPICAL CONDITION

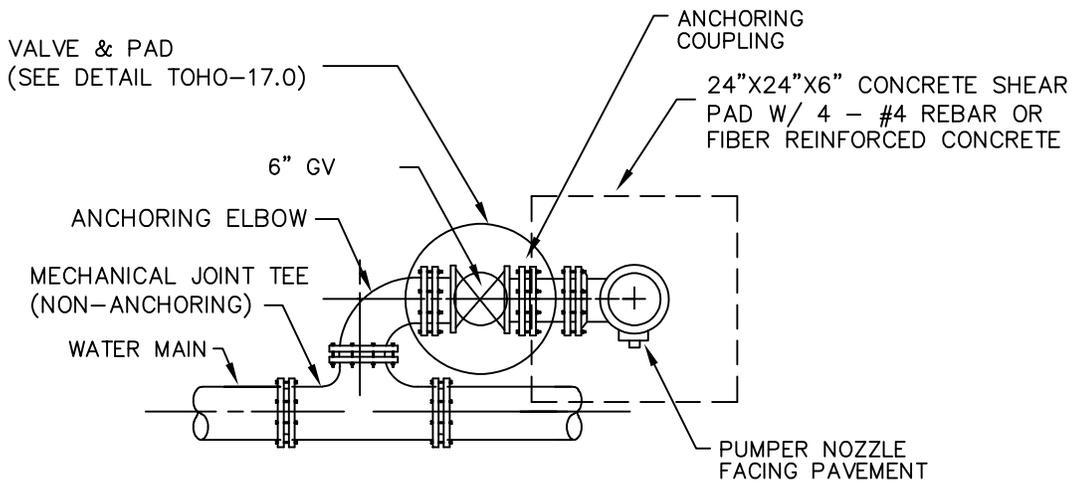

LIMITED RIGHT-OF-WAY CONDITION

NOTES:

1. HYDRANT SHALL BE SUPPLIED WITHOUT A WEEP HOLE OR WITH A PERMANENTLY PLUGGED WEEP HOLE.
2. CLEARANCE BETWEEN BOTTOM OF BOLTS AND FINISH GRADE SHALL BE 6" MINIMUM.
3. CLEARANCE BETWEEN CENTER OF PUMPER NOZZLE AND FINISH GRADE SHALL BE 18" MINIMUM AND 24" MAXIMUM.
4. PLANTING CLEAR AREA(S) SHALL BE PER APPLICABLE FIRE CODE(S).
5. IF HYDRANT IS LOCATED MORE THAN 20 LINEAR FEET FROM THE MAIN OR ON THE OPPOSITE SIDE OF A TRAVELWAY FROM THE MAIN, AN ADDITIONAL GATE VALVE SHALL BE REQUIRED IMMEDIATELY UPSTREAM OF THE HYDRANT.
6. VALVE, VALVE BOX, & PAD SHALL BE INSTALLED PER THE TOHO VALVE & BOX DETAIL TOHO-17.



EFFECTIVE DATE:	04/01/2025
BOARD APPROVED DATE:	01/22/2025
PREVIOUS VERSION:	2022
DRAWN BY:	MP
REVISED BY:	DT

FIRE HYDRANT

DRAWING NUMBER
26